


**Pittsburgh General Hospital
Completion Percentage Report
Fire Alarm System Testing
From 01/01/2008 to 10/10/2013**

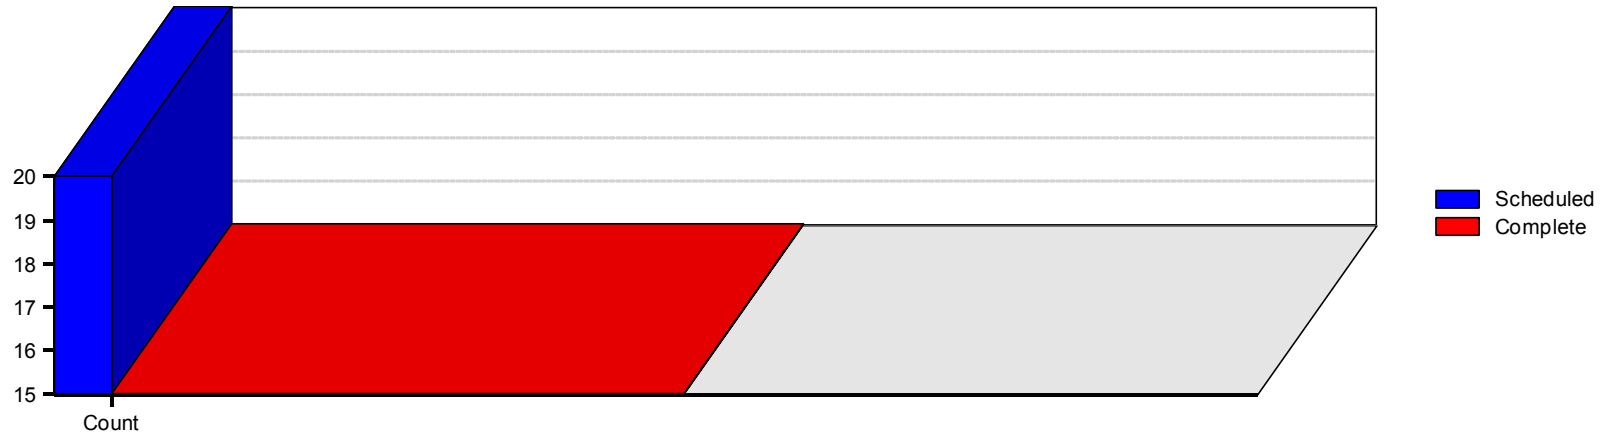

Report Totals:

Total WO's:	20
Total Completed WO's:	15
Completion Percentage:	75.00%

*Includes ACTIV, CMPLT & CLOSE

*Includes CMPLT & CLOSE

**Pittsburgh General Hospital
Completion Percentage Report
Fire Alarm System Testing
From 01/01/2008 to 10/10/2013**

Print Date: 10/10/2013

Status: **ACTIVE**

WO #	Description	Date Due	Asset #	Days Open	Comments\Actions	Hours
15973	A - FIRE ALARM SYSTEM	4/1/2008	FA-03	2018		0.00
15974	A - FIRE ALARM SYSTEM	4/1/2008	FA-04	2018		0.00
15976	A - FIRE ALARM SYSTEM	4/1/2010	FA-02	1288		0.00
15978	A - FIRE ALARM SYSTEM	4/1/2010	FA-04	1288		0.00
15981	A - FIRE ALARM SYSTEM	4/1/2012	FA-03	557		0.00
Total ACTIVE WOs:				5		

Status: **COMPLETED**

WO #	Description	Date Due	Asset #	Date Cmpl	Comments\Actions	Hours
293	A - FIRE ALARM SYSTEM	4/1/2010	FA-01	4/7/2010	PM completed successfully	1.00
294	A - FIRE ALARM SYSTEM	4/1/2010	FA-02	4/26/2010	PM completed successfully	1.00
295	A - FIRE ALARM SYSTEM	4/1/2010	FA-03	4/29/2010	PM completed successfully	0.00
296	A - FIRE ALARM SYSTEM	4/1/2010	FA-04	5/3/2010	PM completed successfully	0.00
9168	A - FIRE ALARM SYSTEM	4/1/2010	FA-01	4/24/2010	PM completed successfully	0.00
9169	A - FIRE ALARM SYSTEM	4/1/2010	FA-02	4/18/2010	PM completed successfully	0.00
9170	A - FIRE ALARM SYSTEM	4/1/2010	FA-03	5/1/2010	PM completed successfully	1.00
9171	A - FIRE ALARM SYSTEM	4/1/2010	FA-04	4/25/2010	PM completed successfully	1.00
15971	A - FIRE ALARM SYSTEM	4/1/2008	FA-01			0.00
15972	A - FIRE ALARM SYSTEM	4/1/2008	FA-02			0.00
15975	A - FIRE ALARM SYSTEM	4/1/2010	FA-01			0.00
15977	A - FIRE ALARM SYSTEM	4/1/2010	FA-03			0.00
15979	A - FIRE ALARM SYSTEM	4/1/2012	FA-01			0.00
15980	A - FIRE ALARM SYSTEM	4/1/2012	FA-02			0.00
15982	A - FIRE ALARM SYSTEM	4/1/2012	FA-04			0.00
Total COMPLETED WOs:				15		