


Pittsburgh General Hospital
Monthly Fire Sprinkler System Testing
 From 01/01/2012 to 01/31/2012

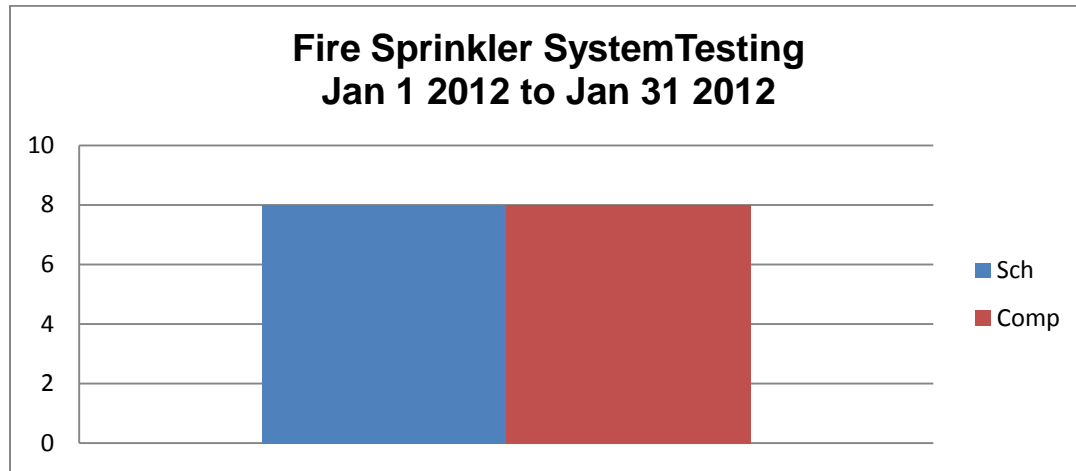

WO#	Description	Due Date	Asset #	Date Completed	Comments	M/H
17646	Weekly fire pump test	1/1/2012	AFSS1234	1/2/2012	No problems identified	0.5
17647	Weekly fire pump test	1/8/2012	AFSS1235	1/8/2012	No problems identified	0.5
17648	Annual fire pump flow test	1/15/2012	AFFS1236	1/25/2012	Annual testing performed by contractor Fire Marshal and insurance company rep on-site for verification	6.5
16966	Weekly fire pump test	1/15/2012	AFSS1237	1/25/2012	No problems identified	0.5
17516	Weekly fire pump test	1/24/2012	AFSS1238	1/24/2012	Packing adjusted on main shaft	0.5
17834	Monthly fire pump test	1/15/2012	AFSS1239	2/27/2012	Fire pump tested on commercial power and emergency power	2.5
17515	Quarterly zone 1 flow test	1/24/2012	AFSS1240	2/28/2012	Alarm sounded at 53 seconds from start of flow	1.0
17651	Quarterly zone 3 flow test	1/24/2012	AFSS1241	1/25/2012	Alarm sounded 44 seconds from start of flow	1.0
17873	Quarterly zone 5 flow test	1/24/2012	AFSS1242	1/28/2012	Alarm sounded in excess of 90 seconds first test; Adjusted flow switch retested at 51 seconds.	2.5
Account Total:		8 Completed:		8 Complt Pcnt:		100.00% 15.5